




# Installation of Pipeline under Council Road Policy



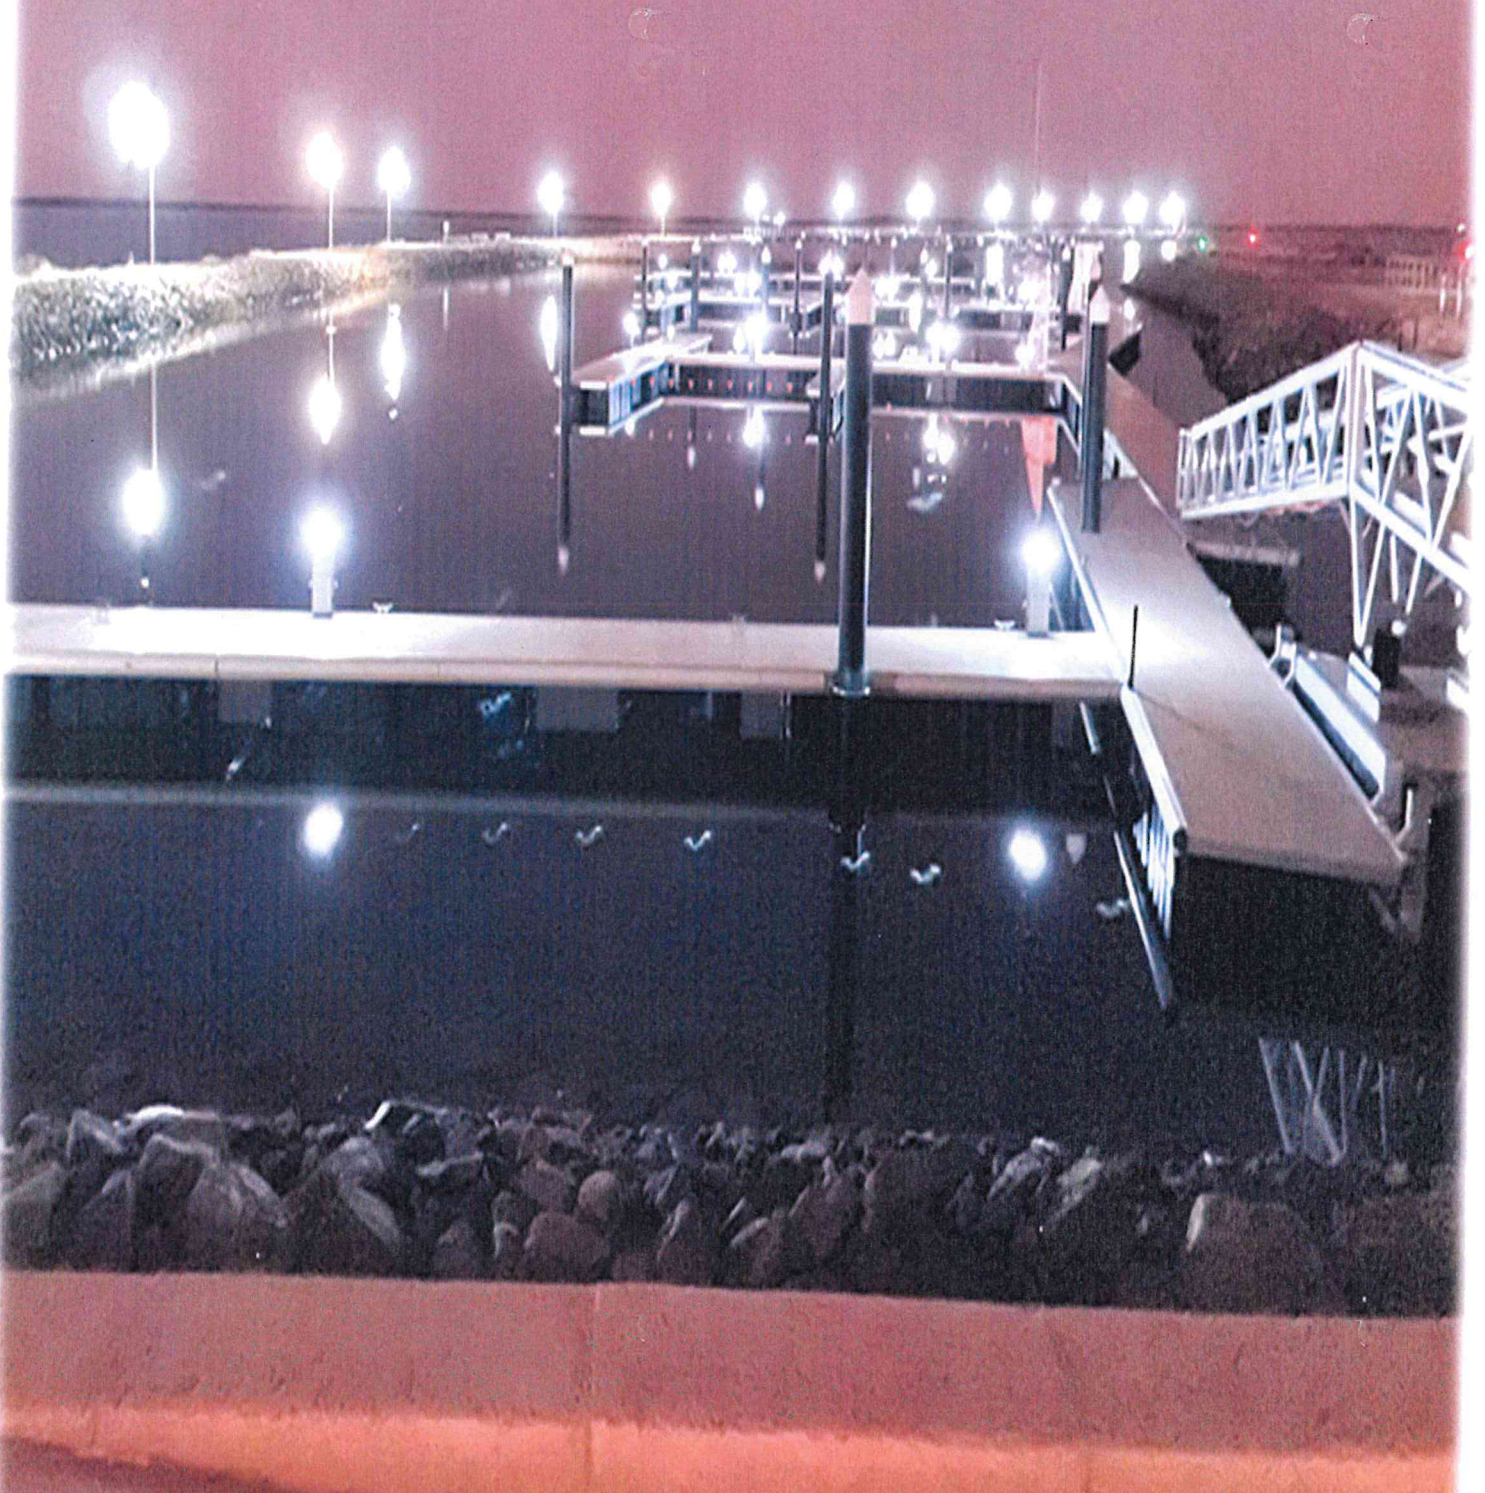

## Installation of Pipeline under Council Road Policy

Name of Council	District Council of Franklin Harbour
Responsibility	Risk Management
Revision Number	1.3
Effective date	September 2023
Last revised date	July 2019
Minutes reference	81/09/23
Next review date	July 2027


### Installation Requirements:

1. Council permission to be obtained.
2. Application form to be completed and signed by applicant.
3. Paddock section number and Hundred from where pipeline is being laid and section number and hundred of paddock where pipe is to be taken.
4. Trench depth to be 600mm fence to fence.
5. Pipe to be laid 90° to the road i.e. not to cross at an angle.
6. Pipe to be class 12.5 or equivalent, or B class in steel conduit under roadway.
7. Cable locations – 1100 “Dial Before you Dig” to be undertaken prior to excavation. Landowner responsibility.
8. Road to be left in the same and safe condition after pipe laying. If rubble road, rubble to be reinstated and compacted in two layers with suitable onsite material.
9. Markers to be placed on each side of the roadway stating “pipe line”. These signs to be permanently maintained by the landowners.
10. All pipes placed in roads shall be the responsibility of the landowner. Council will not be liable for any damage.
11. Native Vegetation Act will require that landowner enquires of Council whether placement of pipe will be in a significant site.



## Installation of Pipeline under Council Road Policy

SIGNED:

  
.....  
Chief Executive Officer

Date: 6 / 10 / 23

### Change History

Version	Issue Date	Change
1.0	June 2012	New Policy
1.1	October 2015	Reviewed and Updated (Post election)
1.2	July 2019	Reviewed and Updated (Post election)
1.3	September 2023	Reviewed and Updated (Post election)